



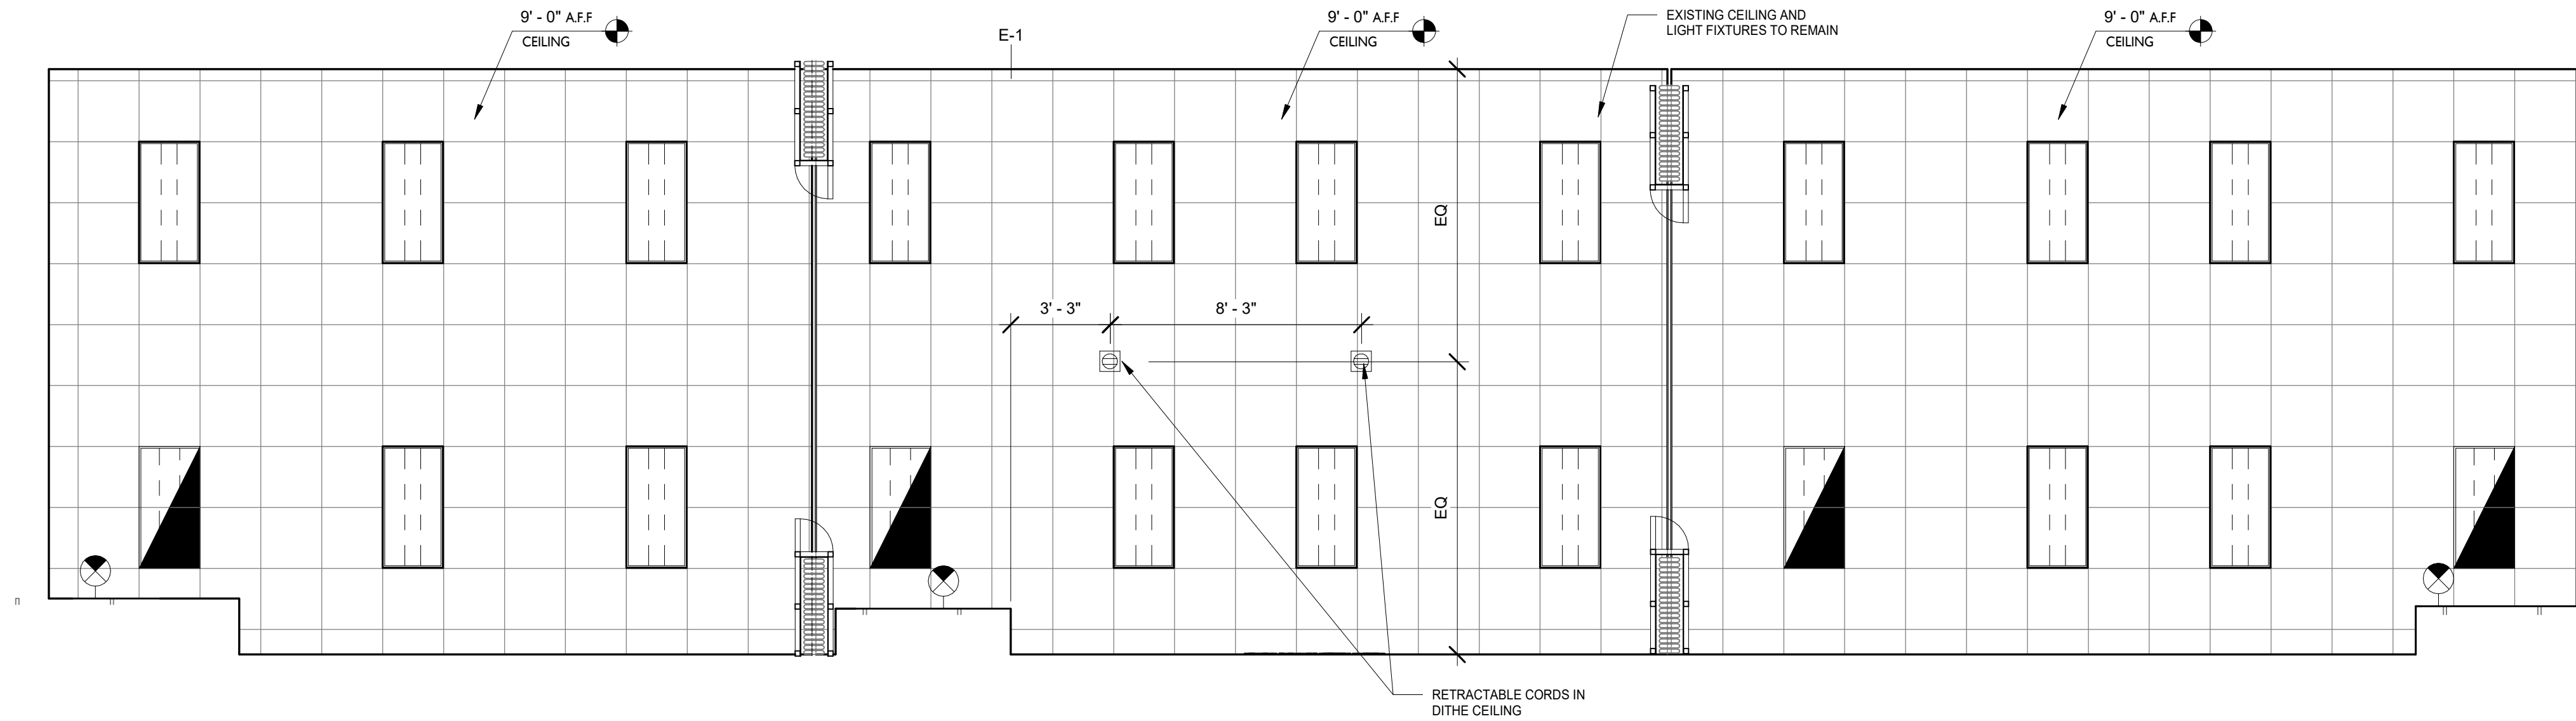

1 Ground Floor Reflected Ceiling Plan
A2.1 Scale: 1/4" = 1'-0"

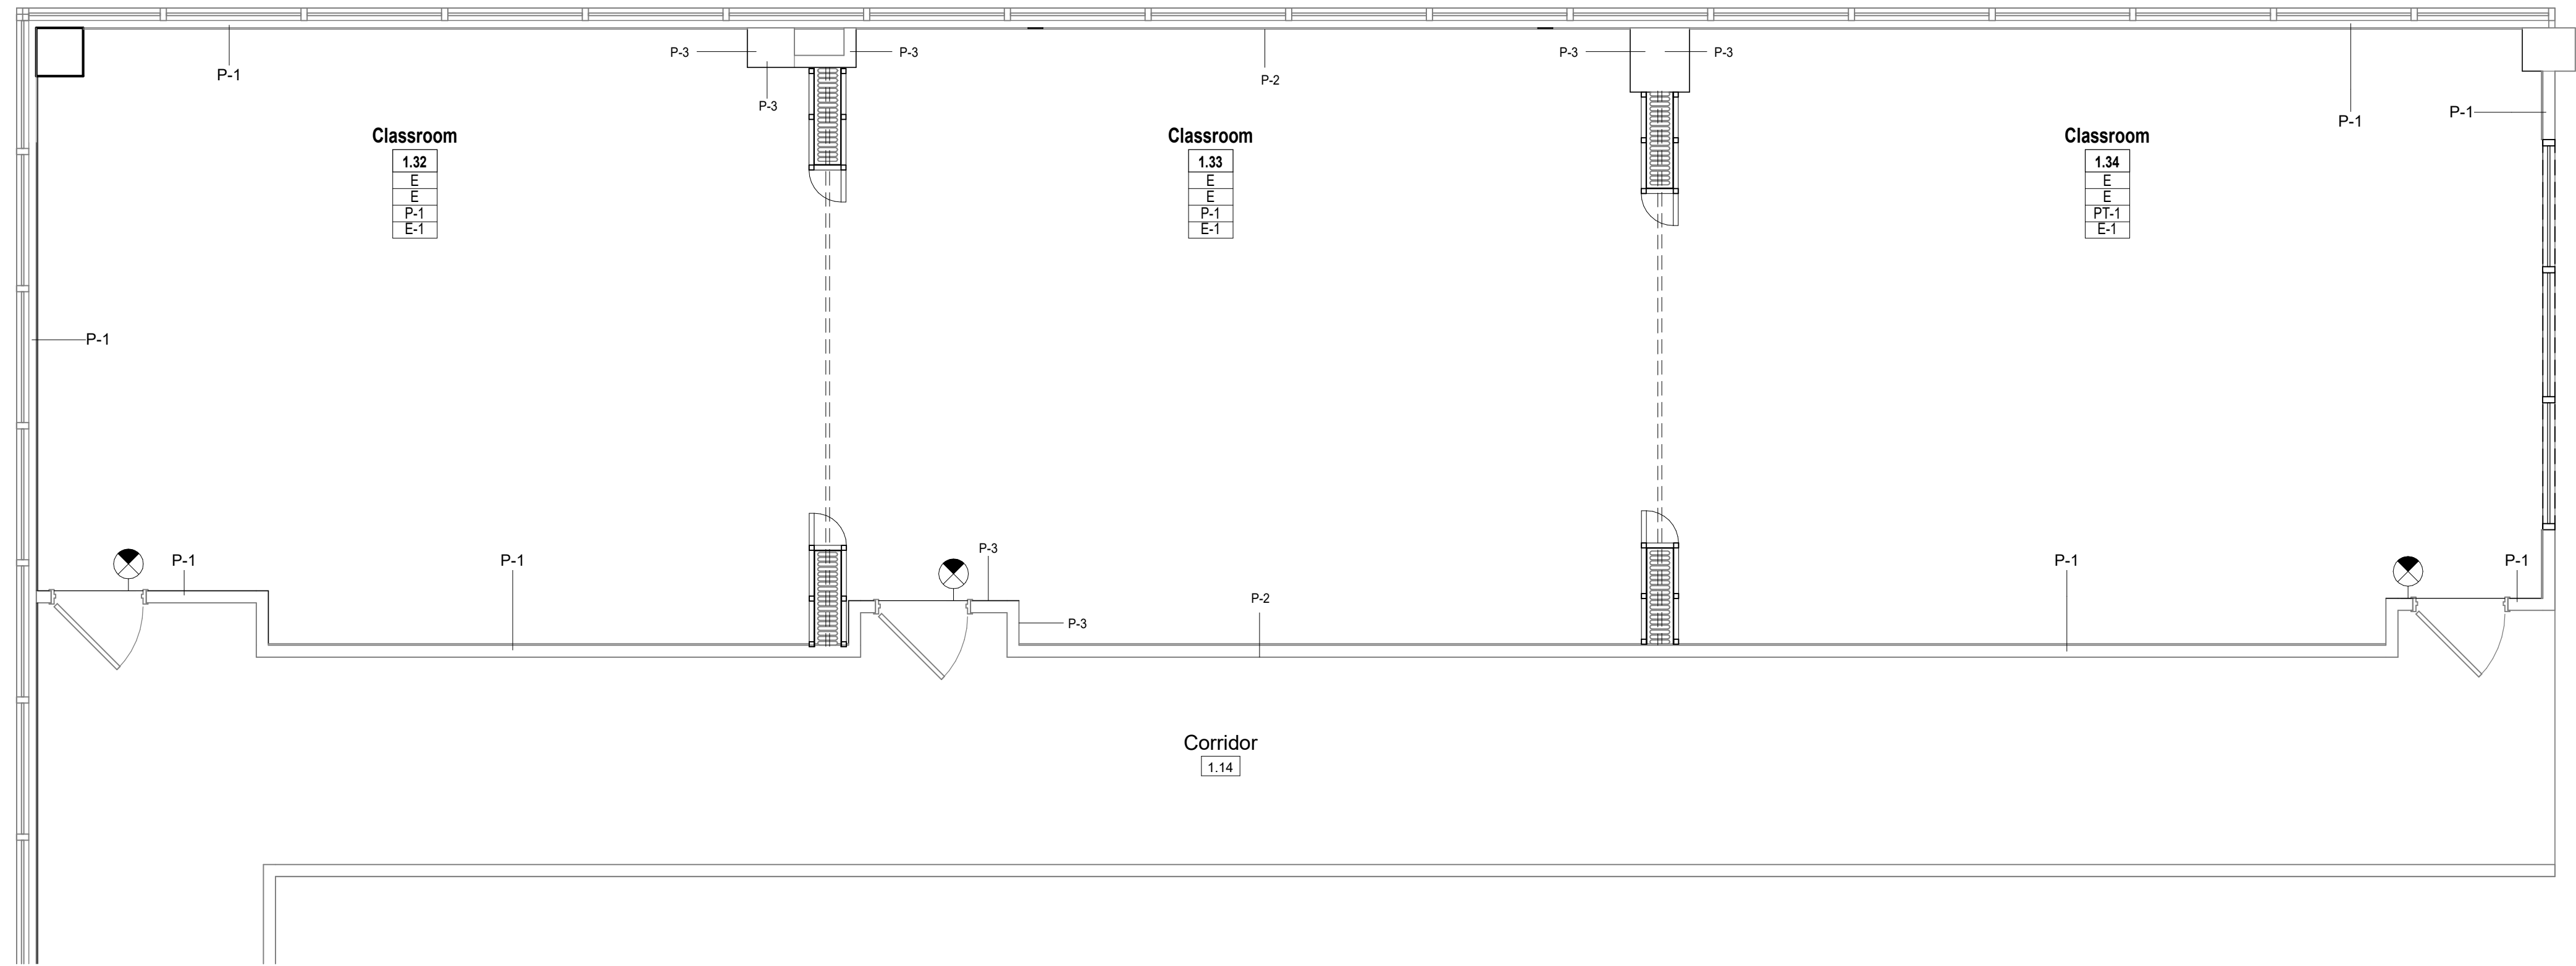

2 Floor Finish Plan
A2.1 Scale: 1/4" = 1'-0"

Finish Schedule

MARK	DESCRIPTION
E	EXISTING FINISH TO REMAIN AS IS, NO NEW FINISH IS REQUIRED
P-1	GENERAL PAINT - PAINT TO MATCH EXISTING, SEE SHEET 2.1 FOR PAINT PRODUCTS TO BE USED IN VARIOUS ROOM TYPES/USES, AND FOR ALTERNATE PAINT MANUFACTURERS.
P-2	ACCENT PAINT - MANUFACTURER: BENJAMIN MOORE, HC-181, SHEEN: SEMI-GLOSS, ONE COAT OF PRIMER AND TWO COATS OF PAINT.
P-3	ACCENT PAINT - MANUFACTURER: BENJAMIN MOORE, AF-655, SHEEN: SEMI-GLOSS, ONE COAT OF PRIMER AND TWO COATS OF PAINT.

Interior Material Finish Classification									
OCCUPANCY	EXITS			EXIT ACCESS CORRIDORS			OTHER SPACES		
	WALL	CEILING	FLOOR	WALL	CEILING	FLOOR	WALL	CEILING	FLOOR
BUSINESS	B	B	III	C	C	III	C	C	III
STORAGE	C	C	III	C	C	NA	C	C	III

NOTES:

1. PER FBC 720.2 CONCEALED INSTALLATION - INSULATING MATERIALS, WHERE CONCEALED AS INSTALLED IN BUILDINGS OF ANY TYPE OF CONSTRUCTION, SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450.


EXCEPTION: CELLULOSIC FIBER LOOSE-FILL INSULATION COMPLYING WITH THE REQUIREMENTS OF SECTION 720.6 SHALL NOT BE REQUIRED TO MEET A FLAME SPREAD INDEX REQUIREMENT BUT SHALL BE REQUIRED TO MEET A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450 WHEN TESTED IN ACCORDANCE WITH CANULC S102.2.

2. PER FBC 904.4.2 INTERIOR FLOOR FINISHES SHALL COMPLY WITH MINIMUM CLASS II CRITICAL RADIANT FLUX.


EXCEPTION: WHERE A BUILDING IS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH SECTION 903.3.1.1 OR 903.3.1.2, CLASS II MATERIALS ARE PERMITTED IN ANY AREA WHERE CLASS I MATERIALS ARE REQUIRED, AND MATERIALS COMPLYING WITH DOC FF-1 "PILL TEST" (CPSC 16 CFR PART 1630) OR WITH ASTM D2859 ARE PERMITTED IN ANY AREA WHERE CLASS II MATERIALS ARE REQUIRED.

3. FFPC101.42.3.3.2 INTERIOR WALL AND CEILING FINISH. INTERIOR WALL AND CEILING FINISH MATERIALS SHALL BE CLASS A, CLASS B OR CLASS C IN ACCORDANCE WITH SECTION 10.2 IN STORAGE AREAS AND SHALL BE AS REQUIRED BY 7.1.4 IN EXIT ENCLOSURES

Ceiling Legend

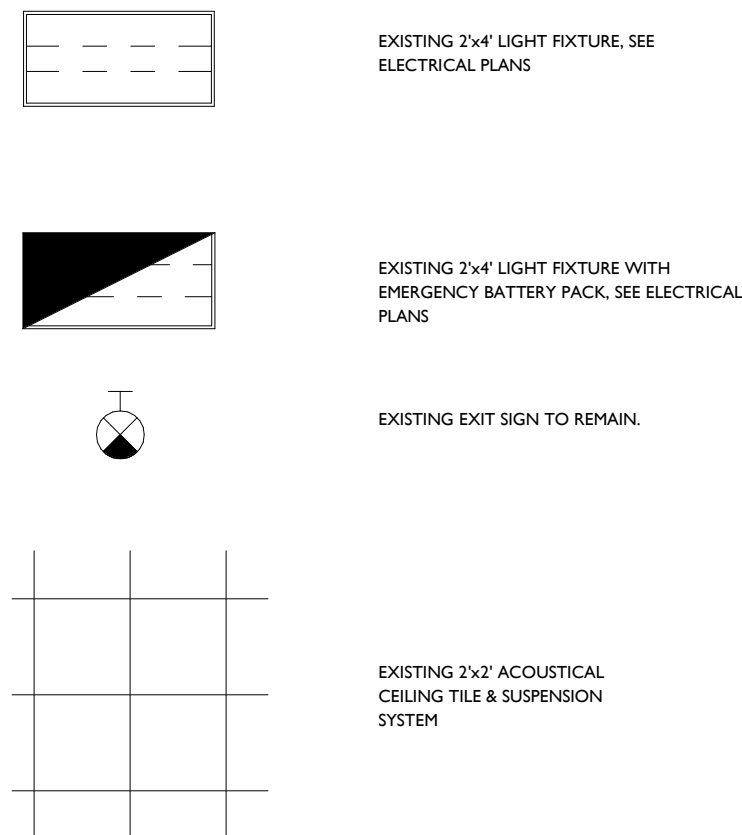

Finish Legend

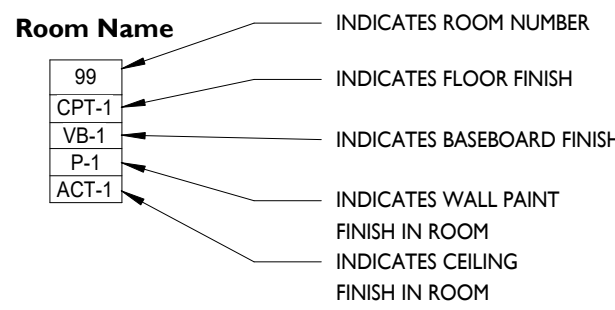

NOTE: SEE FINISH SCHEDULE FOR SPECIFICATION

ARCHITECT SEAL

AGMU HVAC Classroom Renovation

15201 NW 79th Ct.
Miami Lakes, FL 33016

CLIENT

DATE 06/17/26

Revision

PROJECT # 26009

REFLECTED
CEILING &
FINISH PLAN

A2.1